

# Tennant Creek Renewables Report: 7 Jul 2025 - 5 Oct 2025

Renewables  
Penetration:

9.4%

Fossil Fuels:

90.6%


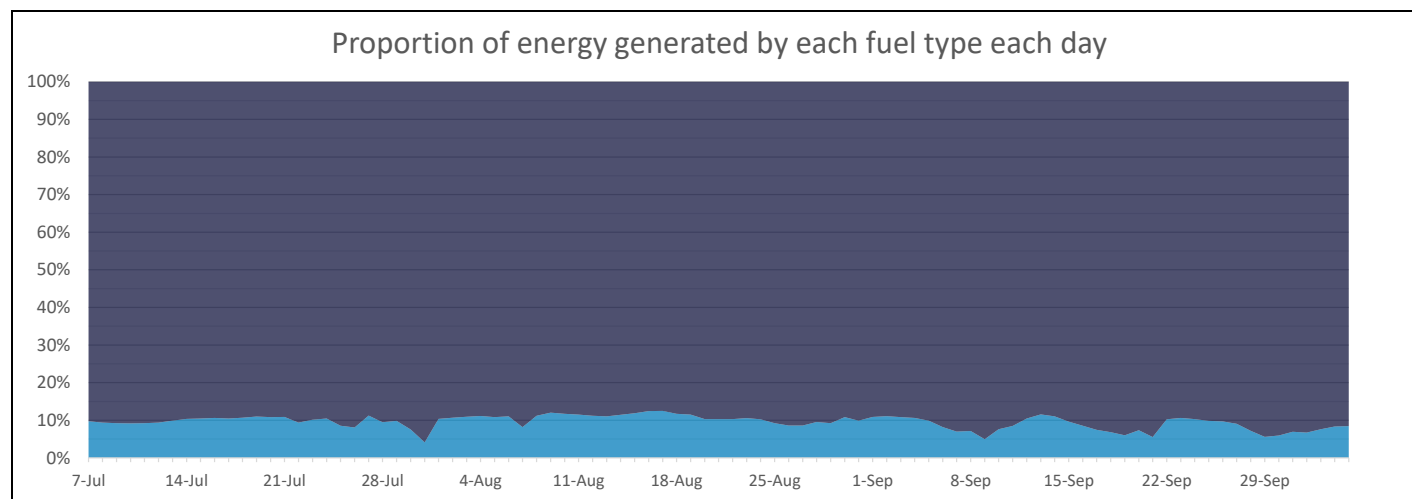
Other Sources\*:

0.0%

Minimum Gross Demand:	1.9	MW @ 3:00, 14 Aug
Maximum Gross Demand:	6.2	MW @ 13:00, 19 Sep
Minimum Net Demand:	1.7	MW @ 14:00, 9 Aug
Maximum Net Demand:	5.6	MW @ 16:00, 19 Sep
Maximum Renewable Power:	1.1	MW @ 12:00, 2 Sep


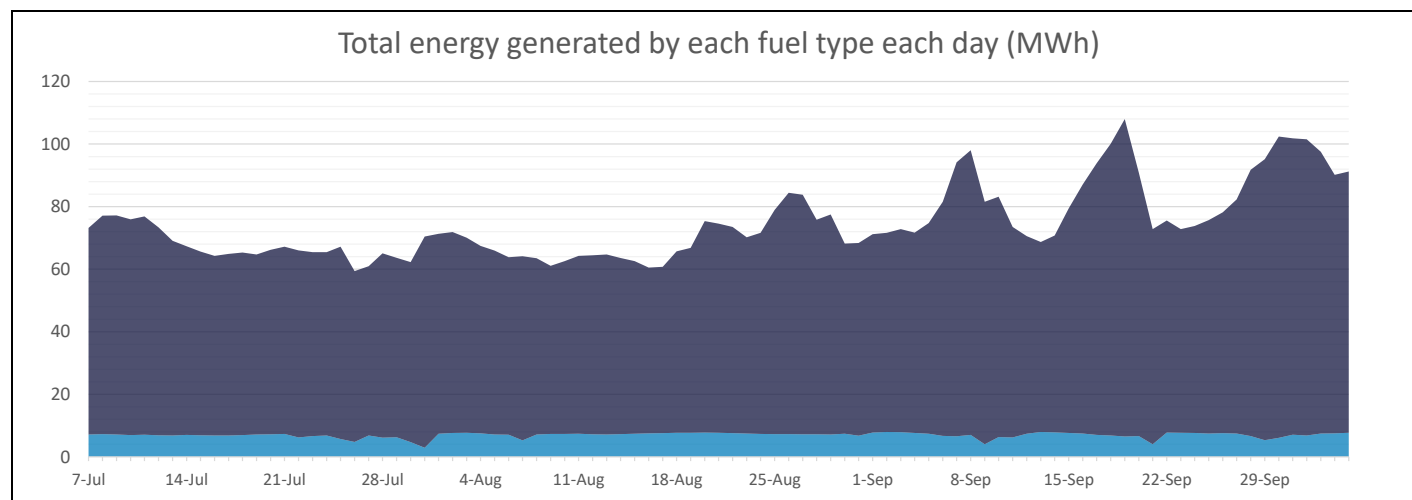
## Total Overall

Fuel	MWh	Percent
Fossil	6,144	90.6%
Biomass	0	0.0%
Steam	0	0.0%
Distributed PV	634	9.4%
Utility Solar	0	0.0%


## Best Hour: 36.7% at 13:00, 17 Aug

Fuel	MWh	Percent
Fossil	1.8	63.3%
Biomass	0.0	0.0%
Steam	0.0	0.0%
Distributed PV	1.0	36.7%
Utility Solar	0.0	0.0%

## Best Week: 11.7% for 11 Aug - 17 Aug

Fuel	MWh	Percent
Fossil	389	88.3%
Biomass	0	0.0%
Steam	0	0.0%
Distributed PV	52	11.7%
Utility Solar	0	0.0%



\* Landfill gas is methane sourced from the Shoal Bay waste facility that is burned to power a generator. This methane is constantly generated by the waste and would otherwise be released into the atmosphere. Therefore, utilising it in this way in fact decreases the emissions by destroying the methane and by offsetting the need for additional fossil fuel generation. (<https://www.epa.gov/lmop/benefits-landfill-gas-energy-projects>)

\* Steam is created using waste heat from fossil fuel generation. The steam is then used to create low-emissions power that offsets the need for additional fossil fuel generation.

### Data sources:

Fossil, Biomass, Steam, Utility Solar:  
PWC PI Historian

Distributed PV:  
3rd party estimated actuals

This report is for informational purposes only and is subject to the accuracy of the source data.